



Vodovodna 95
 1000 Ljubljana
 SLOVENIJA

T: +386 (0)1 428 44 93
 E: nfl@policija.si
www.policija.si


ANALYTICAL REPORT

MMB-CHMICA (C₂₂H₃₀N₂O₃)

methyl 2-{[1-(cyclohexylmethyl)-1H-indol-3-yl]formamido}-3-methylbutanoate

Remark – other active cpd. detected: **none**

Sample ID:	1715-16
Sample description:	powder - white
Sample type:	RM-reference material
Comments ¹ :	CAY Lot#047033627; RESPONSE -purchasing
Date of entry:	1/6/2017

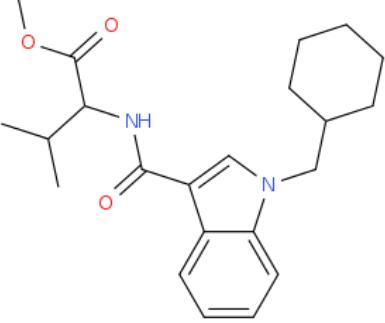Substance identified-structure ² (base form)	
Systematic name:	methyl 2-{[1-(cyclohexylmethyl)-1H-indol-3-yl]formamido}-3-methylbutanoate
Other names:	AMB-CHMICA; methyl (1-(cyclohexylmethyl)-1H-indole-3-carbonyl)valinate; methyl 2-(cyclohexylmethyl)-1H-indole-3-carbonylamino)-3-methylbutanoate;
Formula (per base form)	C ₂₂ H ₃₀ N ₂ O ₃
M _w (g/mol)	370,49
Salt form:	base
StdInChIKey (for base form)	ROWZIXRLVUOMCJ-UHFFFAOYSA-N
Other active cpd. detected	none
Add.info (purity..)	98%

¹ This report has been produced with the financial support of the Prevention of and fight against crime Programme of the European Union (grant agreement number JUST/2013/ISEC/DRUGS/AG/6413). The contents of this report are the sole responsibility of the National Forensic Laboratory and can in no way be taken to reflect the views of the European Commission.

² Created by OPSIN free tool: <http://opsin.ch.cam.ac.uk/> DOI: 10.1021/ci100384d



Report updates

date	comments (explanation)

Supporting information

Analytical technique:	applied	remarks
GC-MS (EI ionization)	+	NFL GC-RT (min): 13,48 BP(1): 240; BP(2): 256, BP(3) :144,
FTIR-ATR	+	direct measurement
GC-IR (condensed phase)	+	always as base form

1. GC-MS (Agilent): GC-method is RT locked to tetracosane (9.258 min). Injection volume 1 ml and split mode (1:50). Injector temperature: 280 °C. Chromatographic separation: on column HP1-MS (100% dimethylpolysiloxane), length 30 m, internal diameter 0.25 mm, film thickness 0.25 µm. Carrier gas He: flow-rate 1.2 ml/min. GC oven program: 170 °C for 1 min, followed by heating up to 190 °C at rate 8 °C/min, then heating up to 293 °C at a rate of 18 °C/min, hold for 7.1 min, then heating at 50 °C/min up to 325 °C and finally 6.1 min isothermal. MSD source EI = 70 eV. GC-MS transfer line T= 235 °C, source and quadropole temperatures 280 °C and 180 °C, respectively. Scan range m/z scan range: from 50 (30 until 6 min.) to 550 (300 until 6 min) amu.

2. FTIR-ATR (Perkin Elmer): scan range 4000-400 cm⁻¹; resolution 4cm⁻¹

3. GC- (MS)-IR condensed phase (GC-MS (Agilent) & IR (Spectra analyses-Danny))

GC-method: Injection volume 1 ml and split mode (1:5). Injector temperature 280 °C. Chromatographic separation as above (1). Split MS : IR = 1 : 9.


MSD source EI = 70 eV. GC-MS transfer line T= 235 °C, source and quadropole temperatures 280 °C and 180 °C, respectively. Scan range m/z scan range: from 50 (30 until 6 min.) to 550 (300) amu.

IR (condensed (solid) phase): IR scan range 4000 to 650, resolution 4 cm⁻¹.


4. HPLC-TOF for exact monoisotopic mass and empirical formula control - results are not shown in the report.

FIGURES OF SPECTRA

MS (EI)

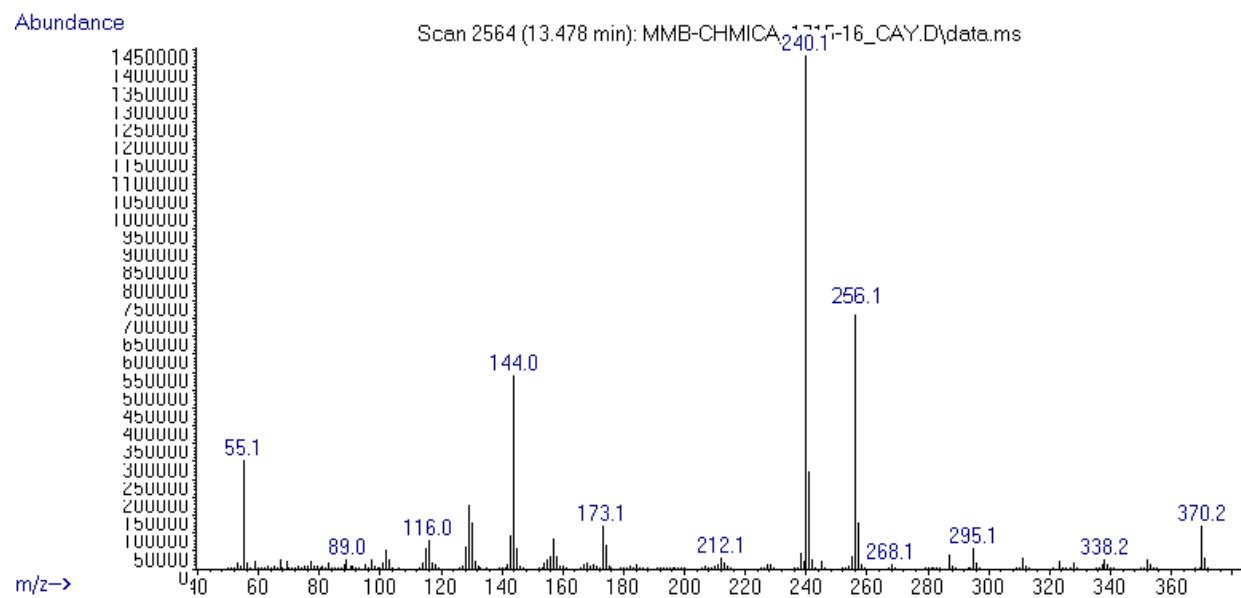

FTIR-ATR (sample as received)

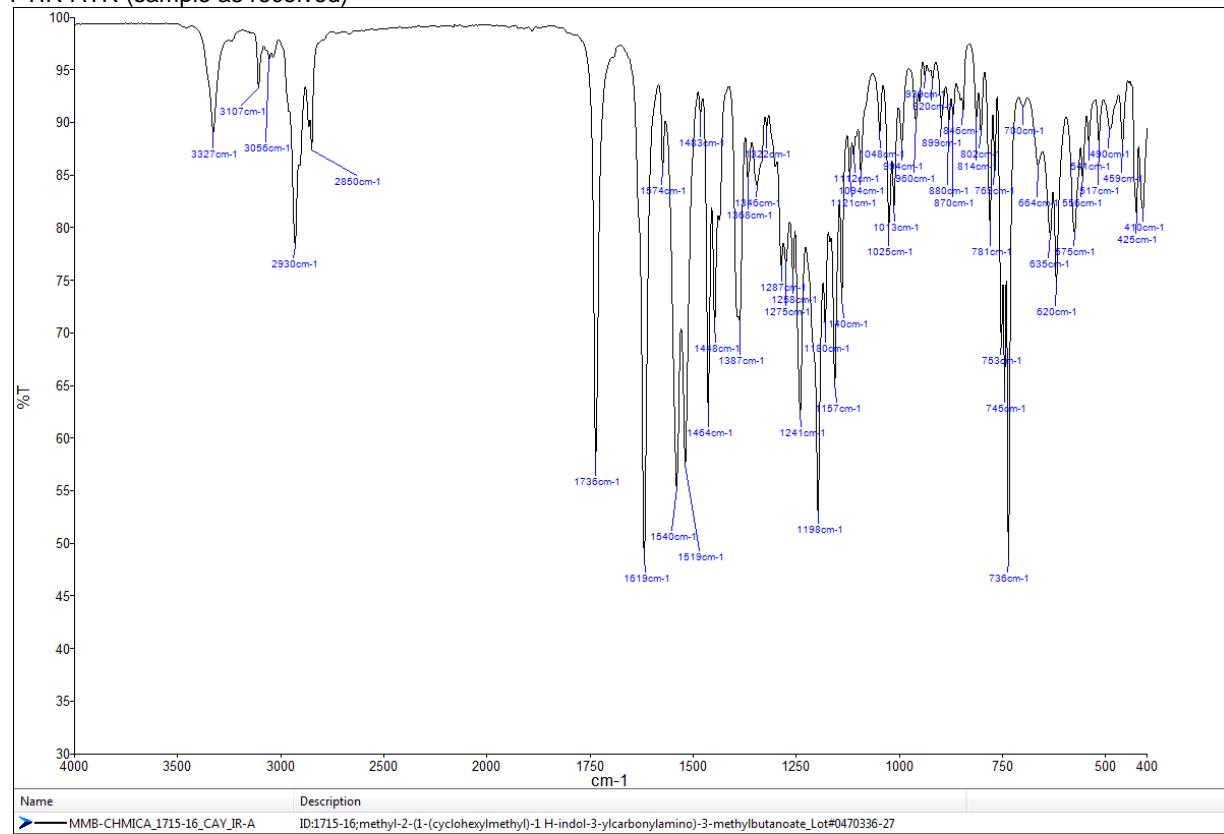

IR-Condensed phase

